

DYNAMIC 11/2 HOUR LABEL FIRE DAMP VERTICAL & HORIZONTAL MOUNT

51BVD & 51BHD • TYPE B





 UL 555 & CAN/ULC-S112 Classified Dynamic Fire Damper, 1 1/2 Hr. Label (File # R25565).

NFPA 80, 90A & 101 compliant.

NBC and IBC building codes compliant.


STANDARD CONSTRUCTION


DEPTH: 4 1/4" (108).

FRAME: Roll formed 20 Ga. galvanized steel with hemmed edge.

BLADE: Roll formed 22 Ga. galvanized steel. Interlocking curtain type blades.

FUSIBLE LINK: 165°F (74 C).



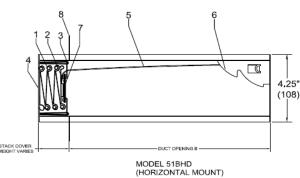

FIRE DAMPER COMPONENTS

- 1. Blade 2. Fusible Link Assembly
- 5. Constant Force Spring
- 6. Lock Ramp

3. Link Strap

- 7. Blade Stiffener
- 8. Blade Stack Cover 4. Frame

OPTIONAL CONSTRUCTION

- Factory supplied Sleeve 22, 20, 18 or 16 GA.
 - *Sleeve length required
- 212°F (100 C) Fusible Link [max. size 48" x 44" (1219 x 1118).
- 1 1/2" x 1 1/2" mounting angles





DYNAMIC CLOSURE RATINGS:

- 2000 fpm (10.2 m/s) on all sizes, vertical or horizontal mount.
- 5000 fpm (25.4 m/s) vertical mount only, up to 24" x 20" (610 x 508) duct size.
- 4" w.g. (1kPa) maximum pressure on all sizes.

MAINTENANCE RECOMMENDATIONS:

NFPA 80 advises that fire dampers be inspected and tested 1 year after installation, then every 4 years minimum (6 years for hospitals). More frequent inspections may be required due to system use and air conditions, or applicable local codes.

NOTES:

Dampers are furnished approximately 1/4" (6) smaller than the given duct dimensions.

These dynamic dampers are UL//ULC approved for use in HVAC systems where the fans remain on in the event of fire.


1½ hr. labeled fire dampers are suitable for use in fire separations with a fire resistance rating of 2 hours or less.

Fire dampers must be installed in accordance manufacturer's instructions. Refer to Alumavent installation instructions for details.

Dimensions are shown in inches (mm).



51BVD & 51BHD • TYPE B

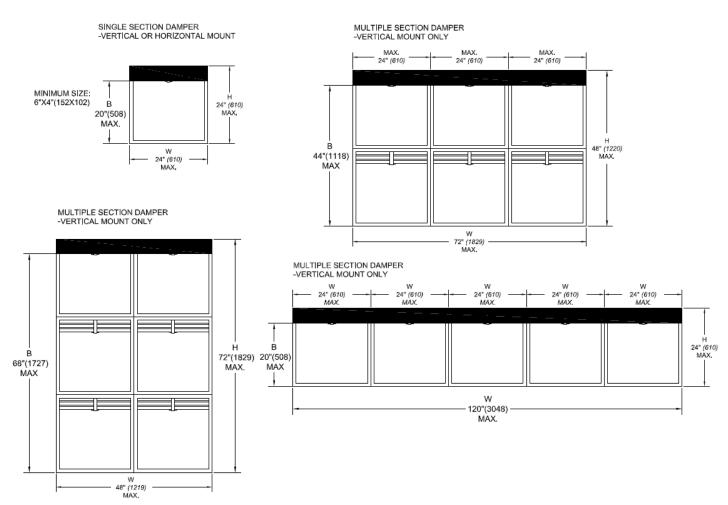

NOTE: SEE TYPE B DYNAMIC SIZING CHART SC51BD FOR OVERALL DAMPER DIMENSIONS.

REF.#	QTY.	DUCT WIDTH (W)	DUCT HEIGHT (H)	MOUNT (V/H)	ACCESSORIES

*DAMPER WILL BE MANUFACTURED APPROXIMATELY $\frac{1}{4}$ " (6) SMALLER THAN GIVEN DUCT DIMENSIONS.

PROJECT NAME:	ENGINEER:	
CONTRACTOR:	SUBMITTAL	DATE:

Dimensions are shown in inches (mm).

Information shown herein is subject to change without notice or obligation.

6/2017